



BY BWP ← | → BY CUSTOMER

PRIOR TO INSTALLTION, THE LOCATION OF THE ASSEMBLY SHALL BE SUBJECT TO THE APPROVAL OF BWP/CROSS-CONNECTION CONTROL SPECIALIST.

LOCATION SHALL BE AS CLOSE TO PROPERTY LINE AS POSSIBLE.

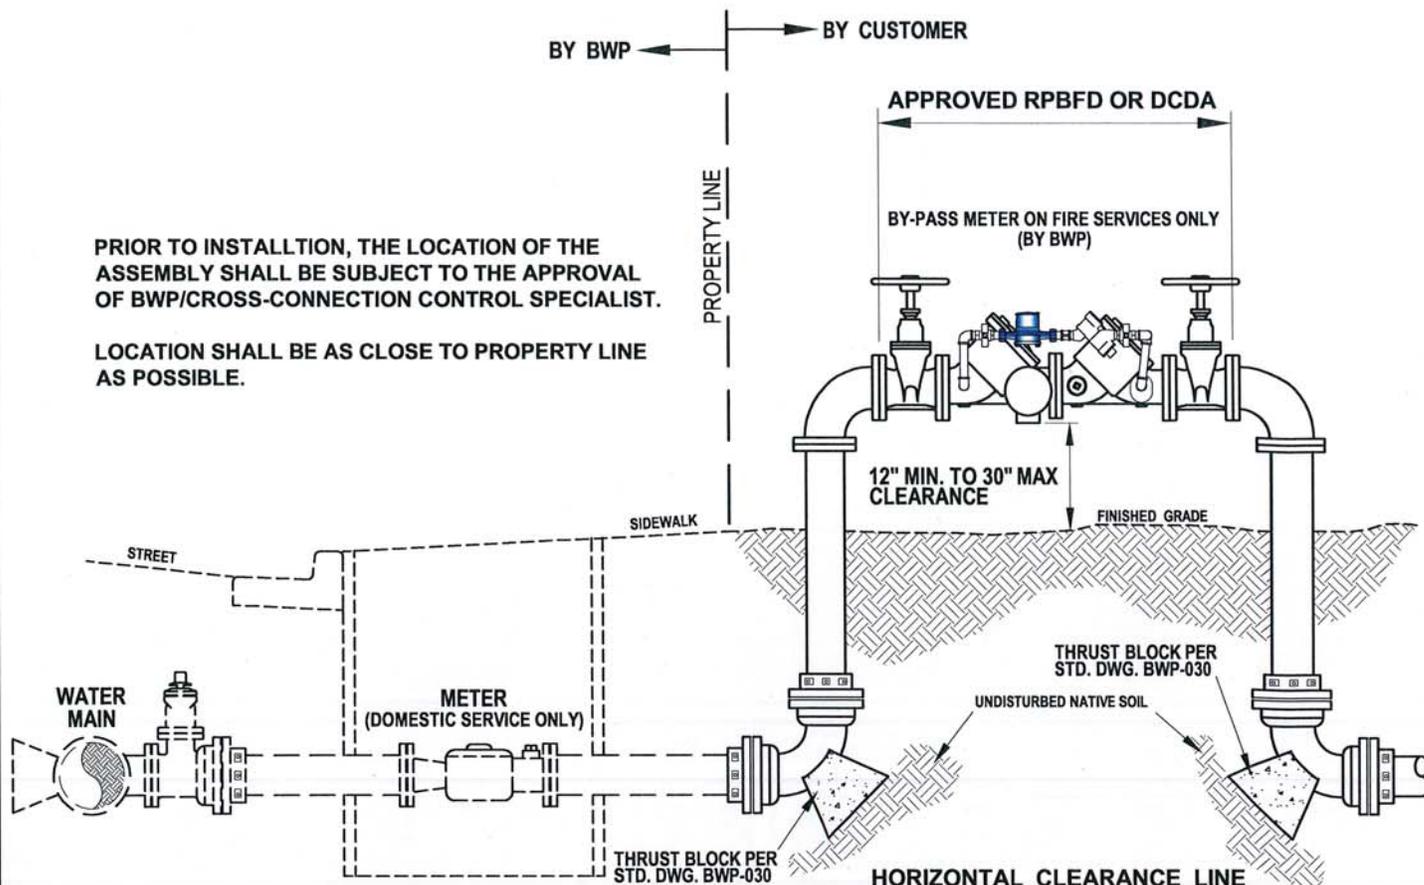

MINIMUM CLEARANCE SCHEDULE		
SIZE	A	B
3/4" - 3"	12"	12"
4" & UP	18"	12"

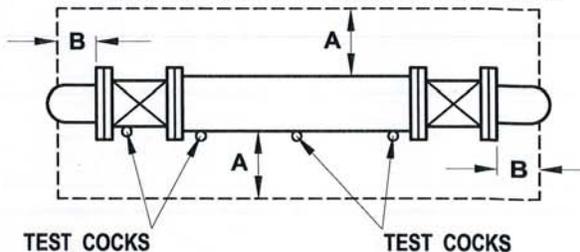

SERVICE TYPE	BACKFLOW ASSEMBLY TYPE
DOMESTIC SERVICE	REDUCED PRESSURE BACKFLOW DEVICE (RPFBD)
FIRE SERVICE	DOUBLE CHECK DETECTOR ASSEMBLY (DCDA)

**NOTES:**

- NEW DEVICES MUST BE INSPECTED AND TESTED IMMEDIATELY AFTER INSTALLATION. PLEASE CALL THE BWP/CROSS-CONNECTION CONTROL SPECIALIST FOR MORE INFORMATION (818) 238-3500
- NO CONNECTIONS OR TEES ARE PERMITTED BETWEEN THE METER AND BACKFLOW PREVENTER POINT OF CONNECTION
- THIS INSTALLATION IS TYPICAL; CLEARANCES SHALL APPLY TO ALL OTHER TYPES OF BACKFLOW PREVENTION DEVICES
- BACKFLOW ASSEMBLIES SHALL BE SAME SIZE AS BUILDING SERVICE LINE
- ALL ASSEMBLIES MUST BE LEAD FREE
- THE BACKFLOW ASSEMBLY SHALL BE FROM THE LIST OF "APPROVED BACKFLOW PREVENTION ASSEMBLIES" BY THE CROSS-CONNECTION CONTROL FOUNDATION, UNIVERSITY OF SOUTHERN CALIFORNIA

ASSISTANT GENERAL MANAGER

*Fred Lantz* 4/24/89  
DATE

C	REVISED NOTE 5	RPY	BN	3/13/11					
B	ADDITIONAL NOTES	RPY	WOM	4/24/02					
A	REVISED NOTES	RPY							
NO.	REVISIONS	BY	CHECK	APP'V'D	DATE				
DRAWN	JJL	SCALE	N.T.S.	CHECK	RRJ	APP'V'D	CRB	DATE	3-21-89

CITY OF BURBANK  
WATER AND POWER

BACKFLOW ASSEMBLY  
INSTALLATION

DRAWING NO.  
**BWP-615**