


CUSTOMER OWNED SERVICE AND METER POLE
APPROVED FOR TEMPORARY SERVICE
THROUGH CABLE RECEPTACLES ONLY

GENERAL NOTES:

- A. SERVICE DROP MINIMUM CLEARANCES:
 AT CENTER OF STREET.....18'
 AT CURB LINE.....16'
 OVER COMMERCIAL/INDUSTRIAL DRIVEWAYS...16'
 OVER PARKING AREAS.....16'
 OVER RESIDENTIAL DRIVEWAYS.....12'
 OVER AGRICULTURAL AREAS.....15'
 NEAR POOL, WATER SURFACE.....RADIAL 22.5'
 OVER TROLLEYS, RAILROADS OR FOR OTHER
 SPECIAL CONDITIONS CONSULT BWP SERVICE
 REP AT 818-238-3575
- B. NORMAL HEIGHT OF POLE IS SHOWN ON
 DRAWING. WHERE ABOVE CLEARANCES CANNOT
 BE OBTAINED WITH THE POLE SHOWN, A
 LONGER POLE SHALL BE USED.
- C. ALL CONDUIT FITTINGS TO BE RAINTIGHT. WIRE
 IN THE SERVICE ENTRANCE RACEWAY TO BE
 PROVIDED BY CUSTOMER. CONTACT LOCAL
 INSPECTION AUTHORITY FOR WIRE SIZE AND
 INSULATION REQUIREMENTS.
- D. SERVICE EQUIPMENT MUST MEET EUSERC
 REQUIREMENTS AND BE OF PROPER RATING
 FOR LOAD TO BE SERVED.
- E. REQUIRED PERMIT AND INSPECTION MUST BE
 OBTAINED FROM CITY'S INSPECTION
 AUTHORITIES BEFORE SERVICE WILL BE
 CONNECTED BY BWP.
- F. WHEN SINGLE PHASE SERVICE LARGER THAN
 100 AMPERES IS REQUIRED, OR 3-PHASE
 SERVICE IS DESIRED, CONSULT BURBANK
 WATER & POWER AT 818-238-3575.
- G. POLE SHALL BE PLACED AT LEAST 10', BUT
 NOT MORE THAN 75', FROM THE SURFACE
 OF THE CITY'S POLE, & WHERE PRACTICABLE
 AT LEAST 10' LATERALLY FROM THE CENTER
 OF ANY POLE LINE.
- H. POLE SHALL BE LOCATED SO THAT THE
 TOPOGRAPHY OF THE LAND, BUILDINGS, OR
 OTHER OBSTRUCTIONS WILL NOT REDUCE
 CLEARANCES BELOW THOSE SHOWN HEREON.
- I. APPLY FOR SERVICE AT 164 W. MAGNOLIA
 BLVD. FOR FURTHER INFORMATION PHONE
 818-238-3575.
- J. AID-IN-CONSTRUCTION CHARGES MAY APPLY
 AS LISTED IN BWP RULES & REGULATIONS.
 CONTACT BWP SERVICE REP AT 818-238-3575
 FOR DETAILS.

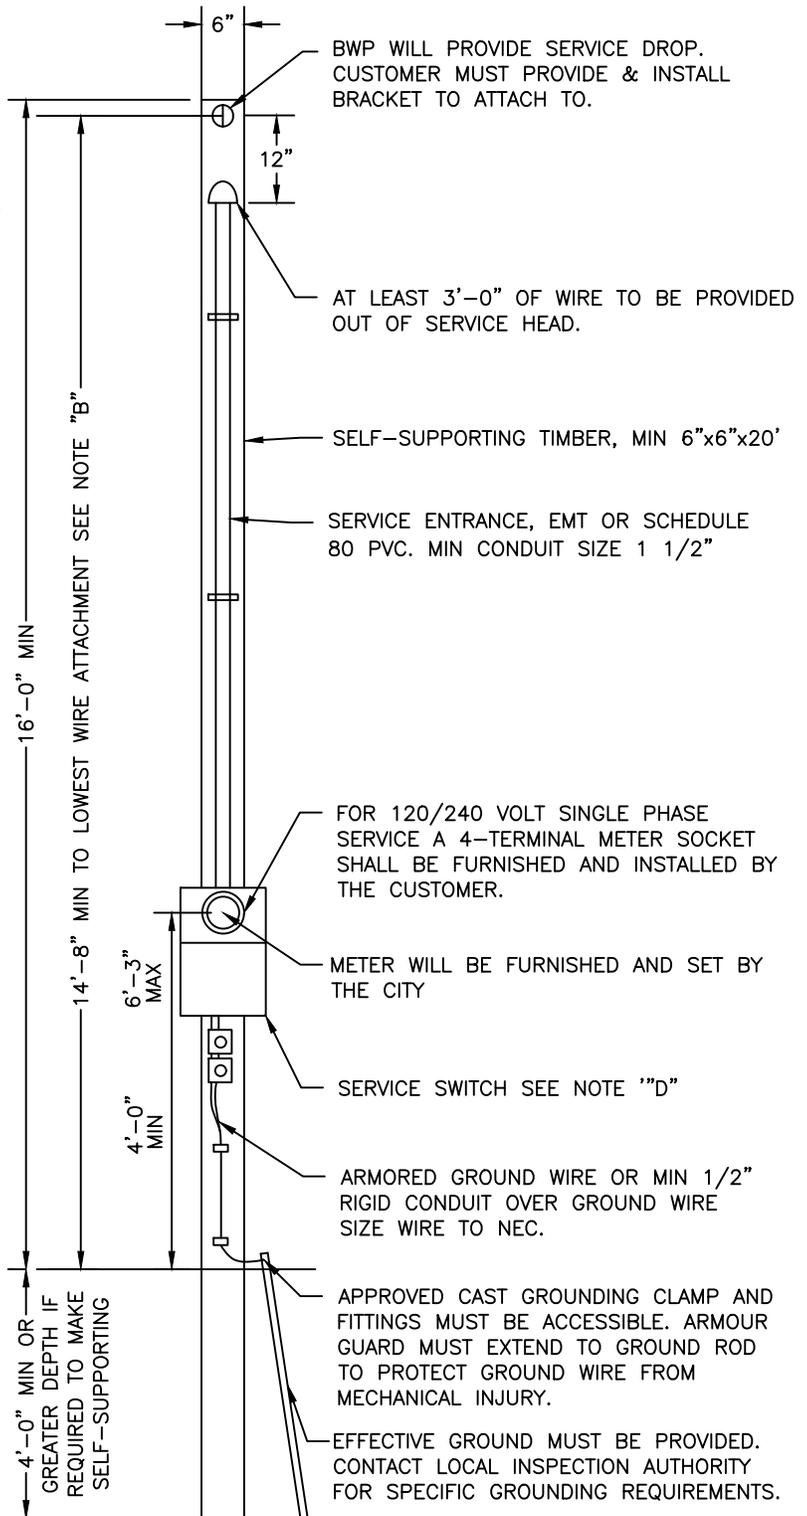

No.	REVISIONS	BY	APPR'V'D	DATE
A	STANDARDIZED FORMATTING	MEP	CJC	5/9/23
	NEW DRAWING	DSL		7/26/06



BURBANK WATER AND POWER - ELECTRIC SERVICES

TEMPORARY OVERHEAD
ELECTRICAL SERVICE
REQUIREMENTS

DRAWING No.
S-709A
Sheet 1 of 1