


4' x 6'-6" x 6' PULLBOX (FOR USE IN ANY AREA SUBJECT TO INCIDENTAL OR DELIBERATE VEHICLE TRAFFIC) WITH ADEQUATE NUMBER OF 12" OR 18" VARIABLE SECTION HEIGHTS TO OBTAIN MIN. 3'-0" COVER OVER DUCT ENCASEMENT. TWO PIECE SLIP RESISTANT GALVANIZED STEEL COVER ENGRAVED WITH BURBANK ELECTRIC (USF HATCH NO. DT93AHD 48X78 1000122674) AND ONE REMOVABLE ENGRAVED I.D. PLATE CAST INTO TOP SECTION W/2 BOLTS FLUSH W/SURFACE. JENSEN PRECAST ASSEMBLY NO. 2000016085, OLD CASTLE NO. 070-X005004-001, OR APPROVED EQUAL.

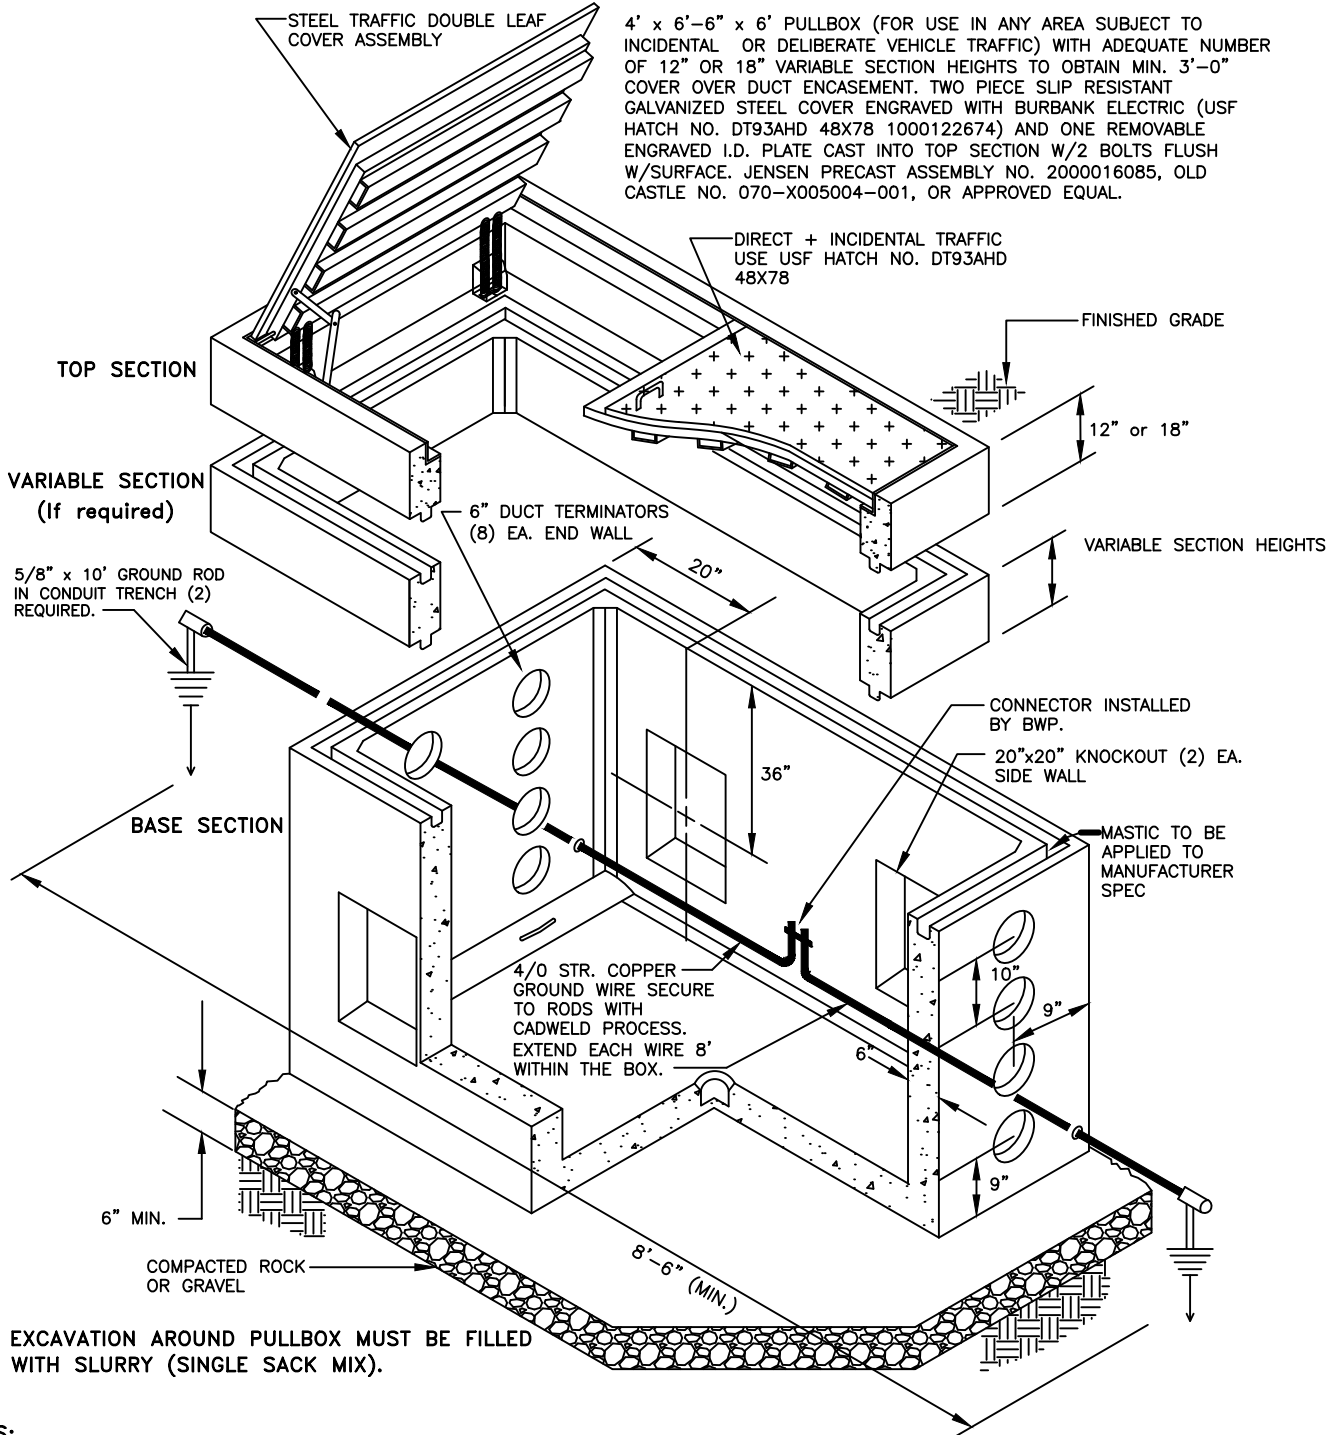

**NOTES:**

1. MINIMUM 48 HOURS BEFORE ORDERING ANY MATERIAL, STARTING CONSTRUCTION, AND PRIOR TO INSTALLATION, CONTRACTOR MUST CALL BWP INSPECTOR AT 818-238-3590 FOR A PRECONSTRUCTION MEETING TO DISCUSS BWP CONSTRUCTION REQUIREMENTS AND SCHEDULE INSPECTION. MUST CALL 48 HOURS PRIOR TO SCHEDULE ALL INSPECTIONS.
2. THE CONTRACTOR MUST INSTALL THE GROUND RODS AND GROUNDING SYSTEM CALLED FOR IN THIS STANDARD WHILE IN THE PRESENCE OF THE BWP INSPECTOR AND TO THE SATISFACTION OF THOSE REQUIREMENTS DETAILED IN THE LATEST VERSION OF THE NATIONAL ELECTRICAL CODE, ARTICLES 250-83 AND 250-84. SEE DWG. S-821 FOR GROUNDING DETAILS.
3. INSIDE OF BOX TO BE PAINTED WHITE. CONCRETE MIX TO BE MIN 5500 PSI AT 30 DAYS, CONTAIN 3 GAL/CU.YD. CORROSION INHIBITOR (ASTM C1582) AND 3LB/CU.YD. MACRO FIBER (ASTM C1116) TYPES GCP DCI AND GCP STRUX 90/40 OR EQUIVALENT.
4. CONTRACTOR TO ALLOW AT LEAST SIX WEEKS LEAD TIME FOR DELIVERY AND TO PROVIDE PULLBOX I.D. NUMBER TO THE MANUFACTURER AT THE TIME OF ORDER. CONTACT MANUFACTURER TO CONFIRM LEAD TIME.

No.	REVISIONS	BY	APPR'V'D	DATE
C	STANDARDIZED FORMATTING	MEP	CJC	5/9/23
B	ADD 6" TERMINATORS/UPDATE MODEL/RENAME	PA/SK		7/24/19
A	ISSUED	NHS		7/16/09



BURBANK WATER AND POWER – ELECTRIC SERVICES

4'x6'-6"x6' CONCRETE  
PULLBOX (TRAFFIC RATED)  
AND GROUNDING REQS.

DRAWING No.

S-729C

Sheet 1 of 1