


3' x 5' x 5' PULLBOX (FOR USE IN ANY AREA SUBJECT TO INCIDENTAL OR DELIBERATE VEHICLE TRAFFIC) WITH ADEQUATE NUMBER OF 12" OR 18" VARIABLE SECTION HEIGHTS TO OBTAIN MIN. 3'-0" COVER OVER DUCT ENCASEMENT. TWO PIECE SLIP RESISTANT GALVANIZED STEEL COVER ENGRAVED WITH BURBANK ELECTRIC (USF HATCH NO. DT93AHD 36X60) AND ONE REMOVABLE ENGRAVED I.D. PLATE CAST INTO TOP SECTION W/2 BOLTS FLUSH W/SURFACE. USF FABRICATION TYPE DT-93 HATCH OR PRE-APPROVED EQUAL, SEE USF DWG 1000122673. PRECAST MANUFACTURER DRAWING TO BE SUBMITTED FOR PRE-APPROVAL PRIOR TO ORDERING.

3' x 5' x 5' PULLBOX (PARKWAY & SIDEWALK USE WITH ALUMINUM COVER) WITH ADEQUATE NUMBER OF 12" OR 18" VARIABLE SECTION HEIGHTS TO OBTAIN MIN. 3'-0" COVER OVER DUCT ENCASEMENT. TWO PIECE SLIP RESISTANT USF ALUM/STEEL COVER TYPE UEZD 36X60 WITH TWO REMOVABLE 3"X24" STAINLESS STEEL PLATES (ONE MARKED WITH "BURBANK ELECTRIC" AND ONE WITH PULLBOX I.D. NUMBER) W/2 BOLTS FLUSH W/SURFACE. THE LETTERS & NUMBERS ENGRAVED ON THE PLATE. USF FABRICATION TYPE UEZD HATCH OR PRE-APPROVED EQUAL. SEE DWG 1000122682. PRECAST MANUFACTURER DRAWING TO BE SUBMITTED FOR PRE-APPROVAL PRIOR TO ORDERING.

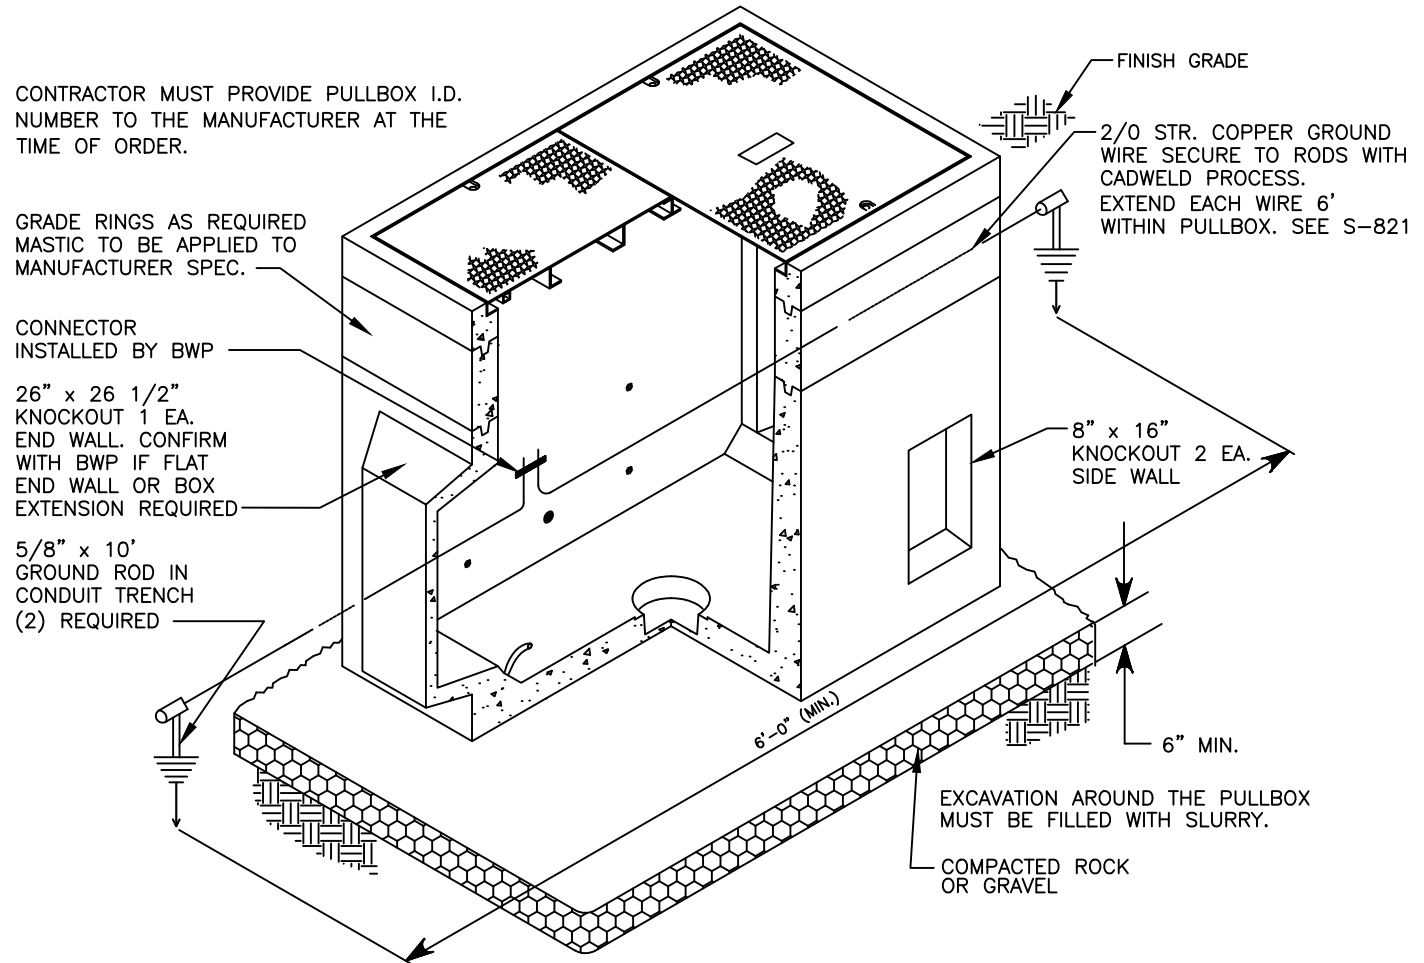

NOTES:

1. MINIMUM 48 HOURS BEFORE ORDERING ANY MATERIAL, STARTING CONSTRUCTION, AND PRIOR TO INSTALLATION, CONTRACTOR MUST CALL BWP INSPECTOR AT 818-238-3590 FOR A PRECONSTRUCTION MEETING TO DISCUSS BWP CONSTRUCTION REQUIREMENTS AND SCHEDULE INSPECTION. MUST CALL 48 HOURS PRIOR TO SCHEDULE ALL INSPECTIONS.
2. THE CONTRACTOR MUST INSTALL THE GROUND RODS AND GROUNDING SYSTEM CALLED FOR IN THIS STANDARD WHILE IN THE PRESENCE OF THE BWP INSPECTOR AND TO THE SATISFACTION OF THOSE REQUIREMENTS DETAILED IN THE LATEST VERSION OF THE NATIONAL ELECTRICAL CODE, ARTICLES 250-83 AND 250-84. SEE DWG. S-821 FOR GROUNDING DETAILS.
3. INSIDE OF BOX TO BE PAINTED WHITE. CONCRETE MIX TO BE MIN 5500 PSI AT 30 DAYS, CONTAIN 3 GAL/CU.YD. CORROSION INHIBITOR (ASTM C1582) AND 3LB/CU.YD. MACRO FIBER (ASTM C1116) TYPES GCP DCI AND GCP STRUX 90/40 OR EQUIVALENT.
4. CONTRACTOR TO ALLOW AT LEAST SIX WEEKS LEAD TIME FOR DELIVERY AND TO PROVIDE PULLBOX I.D. NUMBER TO THE MANUFACTURER AT THE TIME OF ORDER. CONTACT MANUFACTURER TO CONFIRM LEAD TIME.

J	STANDARDIZED FORMATTING	MEP	CJC	5/9/23
H	CHANGED TRAFFIC RATED P.B. COVER TO NON-SPRING ASSISTED.	NHS	DDB	7/17/09
G	UPDATED MANUFACTURER & ASSEMBLY NUMBERS	NHS	DDB	3/26/08
F	REVISED NOTES	PL	DDB	4/30/03
No.	REVISIONS	BY	APPR'V'D	DATE



BURBANK WATER AND POWER – ELECTRIC SERVICES	
3'x5'x5' CONCRETE PULLBOX GROUNDING REQUIREMENTS	DRAWING No. S-460H
Sheet 1 of 1	